

BOROUGH OF **ALPHA, NJ**

**ALPHA BOROUGH
COUNTY OF WARREN STATE OF NEW JERSEY**

2-2023 REQUEST FOR QUOTES

SERVICE LINE QUOTE

April 18, 2023 at 10:00 A.M.

Fair and Open Solicitation in accord with

N.J.S.A.19:44A-20.5

Mayor Craig S. Dunwell

Council President Robert Melick

Councilperson Angela Bickar

Councilperson Louis Cartabona

Councilperson Peter Pettinelli

Councilperson Mike Schwar

Councilperson Jodie Smith

Donna L. Messina Municipal Clerk

Borough of Alpha
Department of Public Works
Quote Request

The Borough of Alpha is requesting quotes from qualified contractors for the scope of work detailed below. Generally, the scope of work will include installation of four (4) Borough side water services, one (1) stainless saddle, and the termination of an existing water service at the main. One (1) water service will be installed in Pohatcong Township, with the balance of the proposed work being constructed in the Borough of Alpha. The successful bidder will be required to obtain a street opening permit from Pohatcong Township and adhere to all restoration requirements in Pohatcong Township. Work performed in the Borough of Alpha will not require street opening permits. Restoration detail for work performed in the Borough is detailed below. Bidders are encouraged to review the attached Google Earth renderings and walk the sites to familiarize themselves with the particulars of each site. All fittings must be Mueller as listed below. Substitutions are permissible with prior written approval from the Borough of Alpha.

RESPOND VIA EMAIL QUOTE NO LATER THAN **APRIL 18, 2023 AT 10:00 A.M. TO:**

Sean P. Canning, Qualified Purchasing Agent
scanning@thecanninggroup.org

Scope

- **East Blvd Water Services** – Two (2) 1” K copper water services from the existing main to the planner strip in the 1200 block of East Blvd. Curbstops with risers are included in the specifications. Bidders should note that this is a new residential development. The developer is seeking a qualified contractor to install the property owner side water services and two (2) sewer laterals. The developer, Alex, can be reached at 908-967-8190. Please see attached Google Earth rendering.
- **East Blvd Saddle Replacement** – A galvanized saddle must be replaced with a stainless steel saddle. Location is at the intersection of East Blvd and Leona St.
- **Sampson Ave Water Service** – A ¾” K copper Borough side water service installation at 920 Sampson Ave. The customer side was replaced with K copper in October 2022. No curbstop or riser are required for this location. See Google Earth rendering.
- **Sampson Ave Service Kill** – Scope of work will include excavating to the main, exposing the corporation stop, turning off the corp and cutting the existing galvanized line from the corp. If the corporation stop is leaking, the corp must be removed and replaced with a stainless steel repair band. A separate “If and where directed” line item is included in the bid.
- **Ringwood Ave Water Service** – A 1” K copper water service from the existing main to a location ten (10) feet from the western edge of Ringwood Street. Curbstop with riser is included in the specifications.

Borough of Alpha Restoration

All disturbed areas in the cartway of public streets must be perimeter saw cut and backfilled with DGA, compacted in 6” lifts. 6” of base asphalt, compacted in two (2) lifts will suffice. The top lift of asphalt should be “deboned” prior to compaction.

All disturbed grassy areas may be backfilled with excavated spoils, compacted in 6” lifts. A minimum of 4” of screened topsoil with seed and mulch must be applied at the surface.

Saddle replacement will require turning down water mains. Only Borough of Alpha DPW employees will turn down mains. Notification to property owners of interruption of water service is the responsibility of Alpha DPW.

Proper signage (“Men Working”, “Road Closed Ahead”, etc) will generally suffice; police traffic control is not required. However, any road closures MUST be reported in advance to Warren County OEM at 908-835-2002.

If a bidder would like to provide tapping saddles and have Borough DPW make the connection at the main, please add \$400 to your bid on the below bid tabulation.

Approved Mueller Parts

- Corporation Valve: B25008N
- Curbstop: B25209N
- 1” SS Tapping Saddle: DR2SCC0659100
- ¾” SS Tapping Saddle: DR2SCC0659075
- SS Repair Clamp for 6” main. Length 12” minimum: 540-12-684
- Curb Box: H-10306

I have read and reviewed the above and understand the scope of work I/we are quoting.

Printed Name

Signature

Date

Company Name: _____

Address: _____

Contact Phone: _____

Representative: _____


Title: _____

Item	Quantity	Unit Price	Extended
1" Water Service, Complete	3		
3/4" Water Service, Complete	1		
1" Saddle Replacement	1		
Service Kill	1		
SS Repair Band *	1		
Borough Tapping Fee		400	
TOTAL:			

*This is "If and Where Directed" only.


Quoted Total (Numbers): _____

Written in words: _____

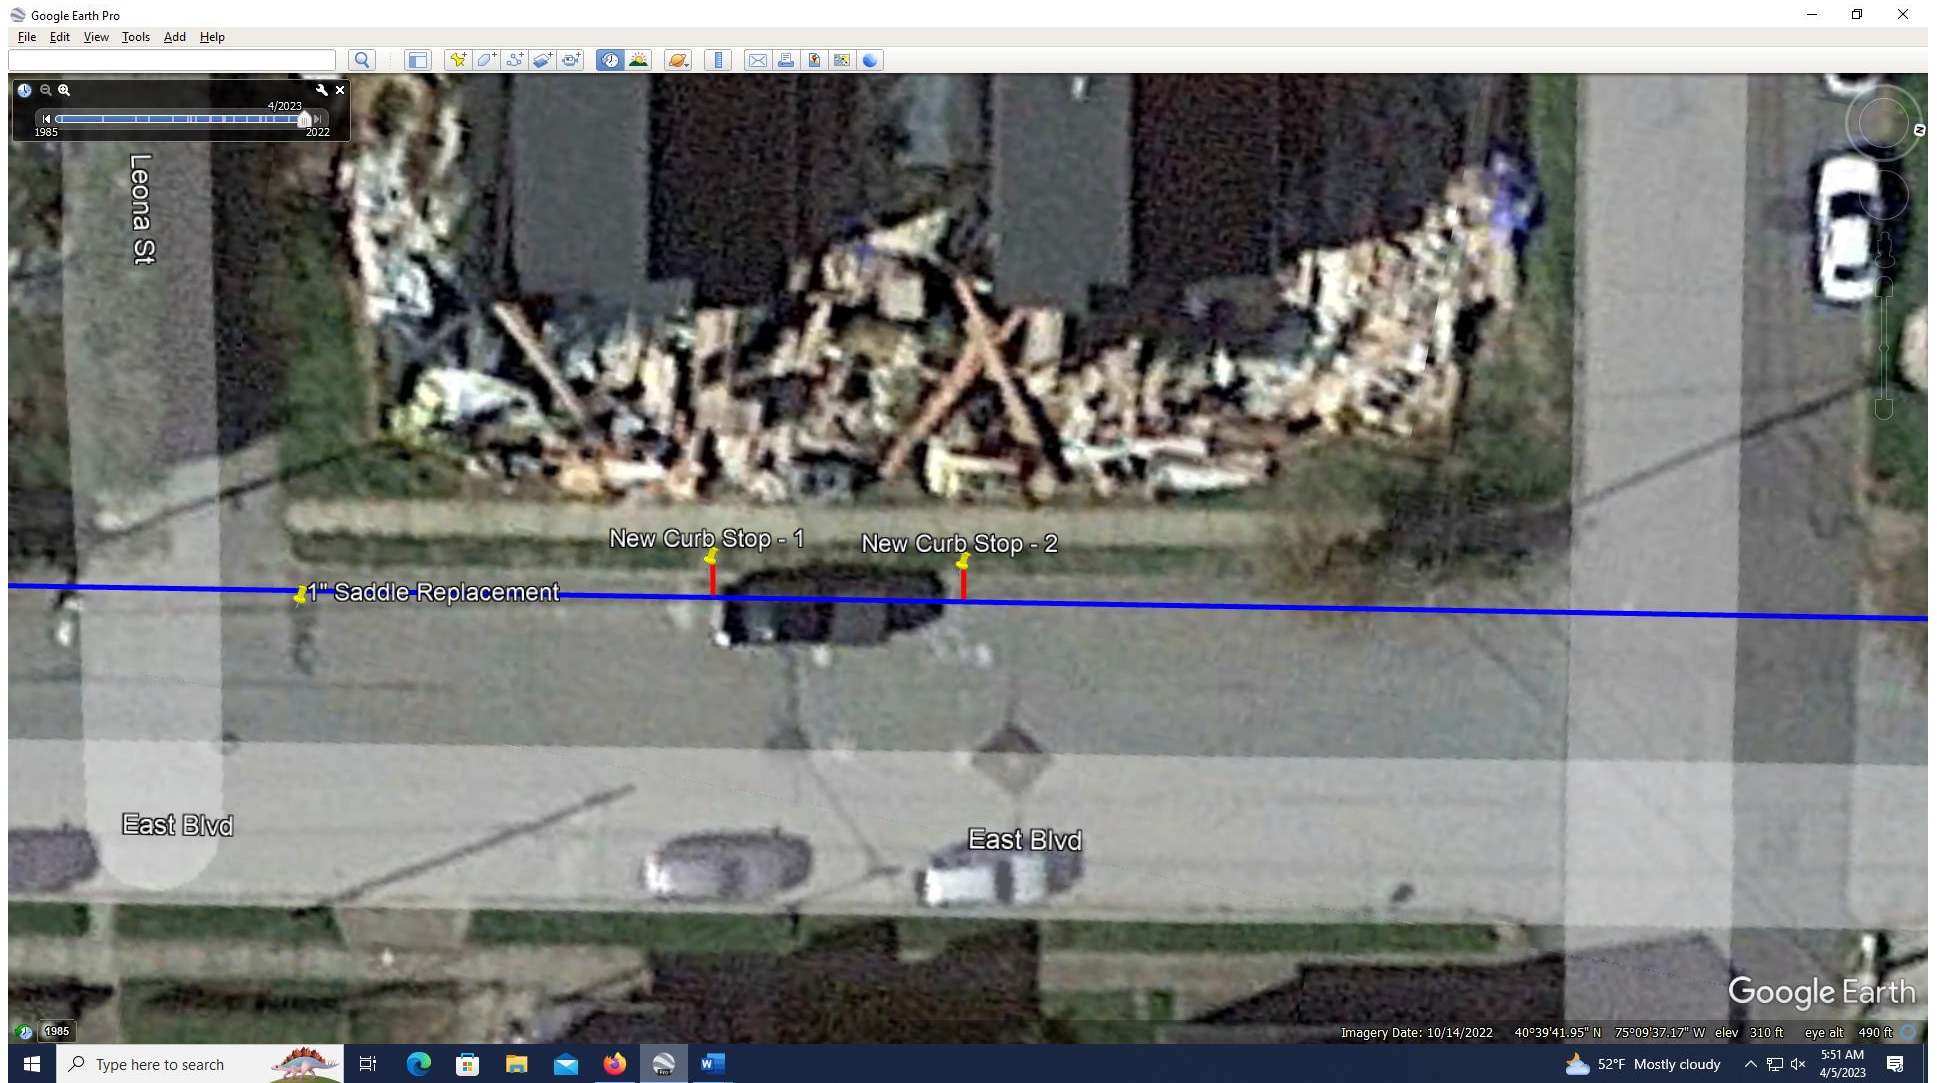

6" Transite main shown in BLUE


Proposed new 1" water services shown in RED – 2 services

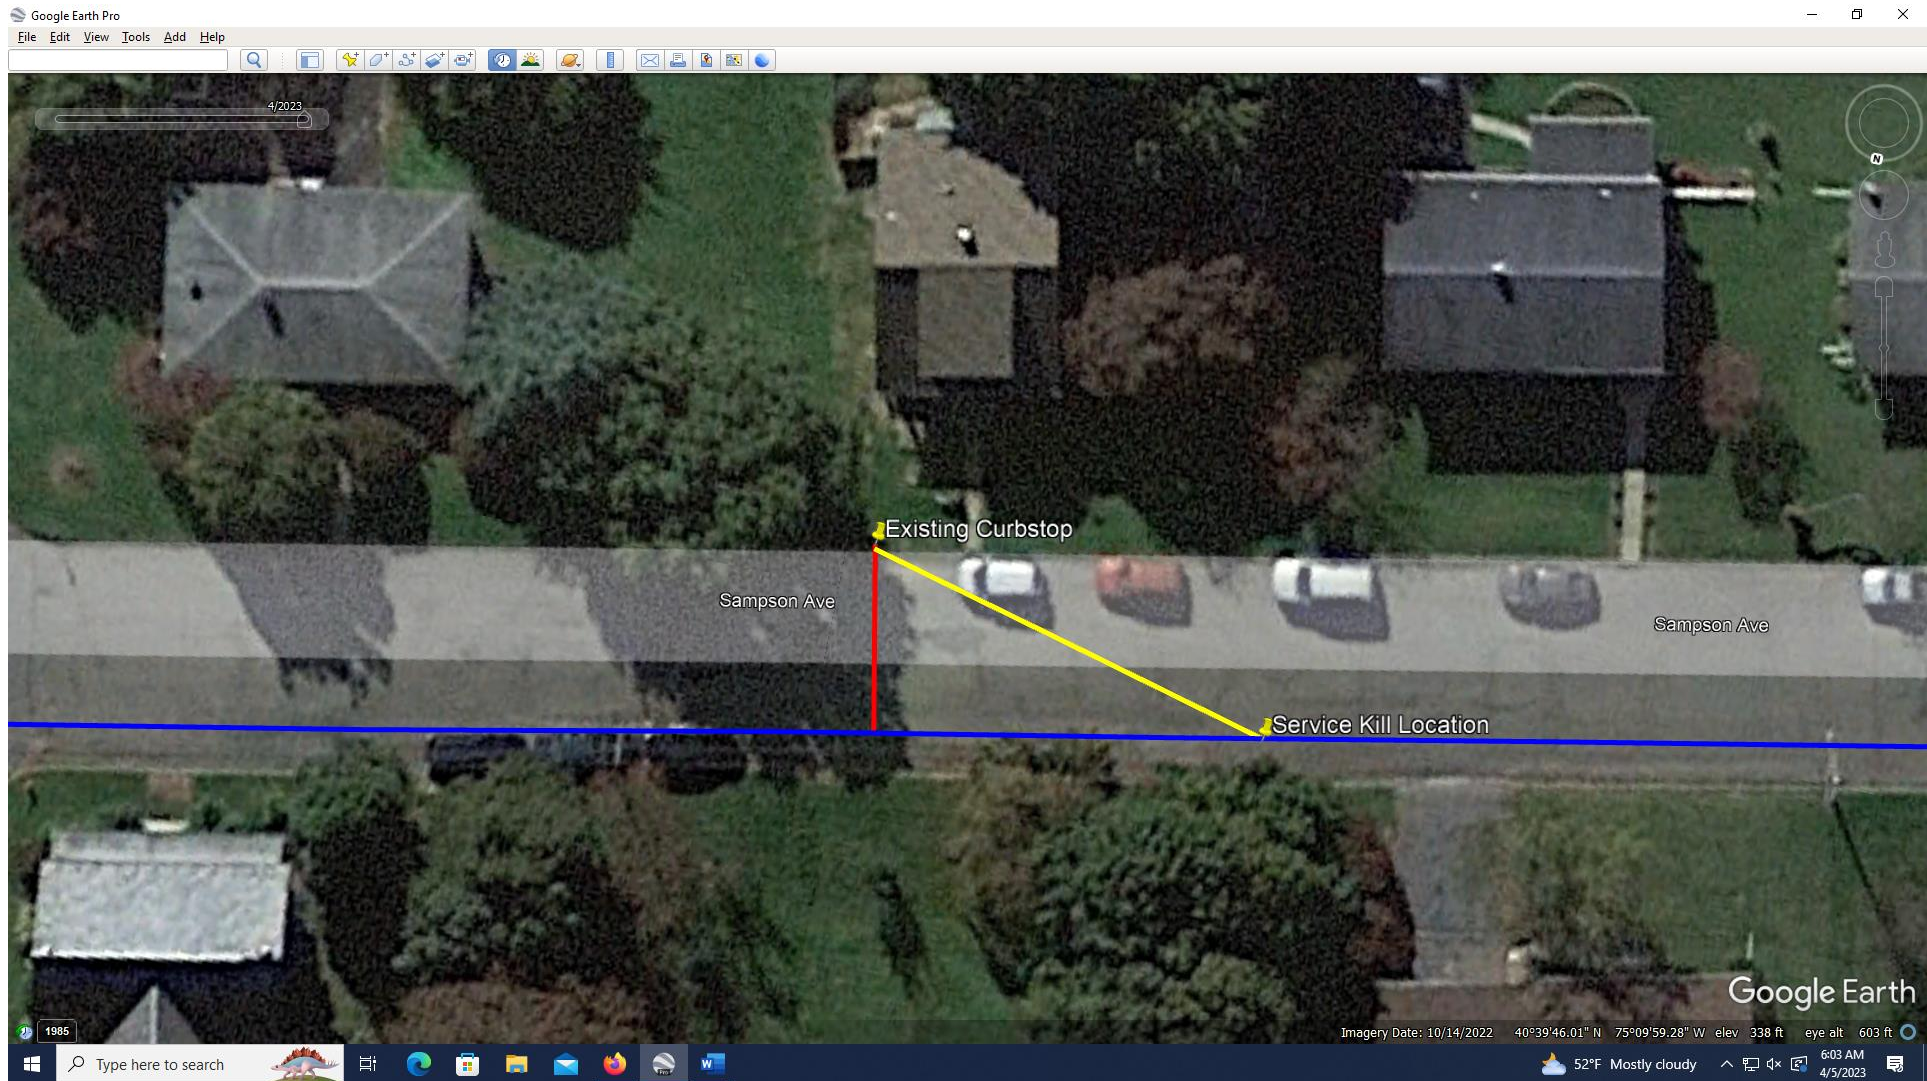

6" Transite main shown in BLUE

Existing 3/4" galvanized service shown in YELLOW

Proposed new 3/4" copper service shown in RED

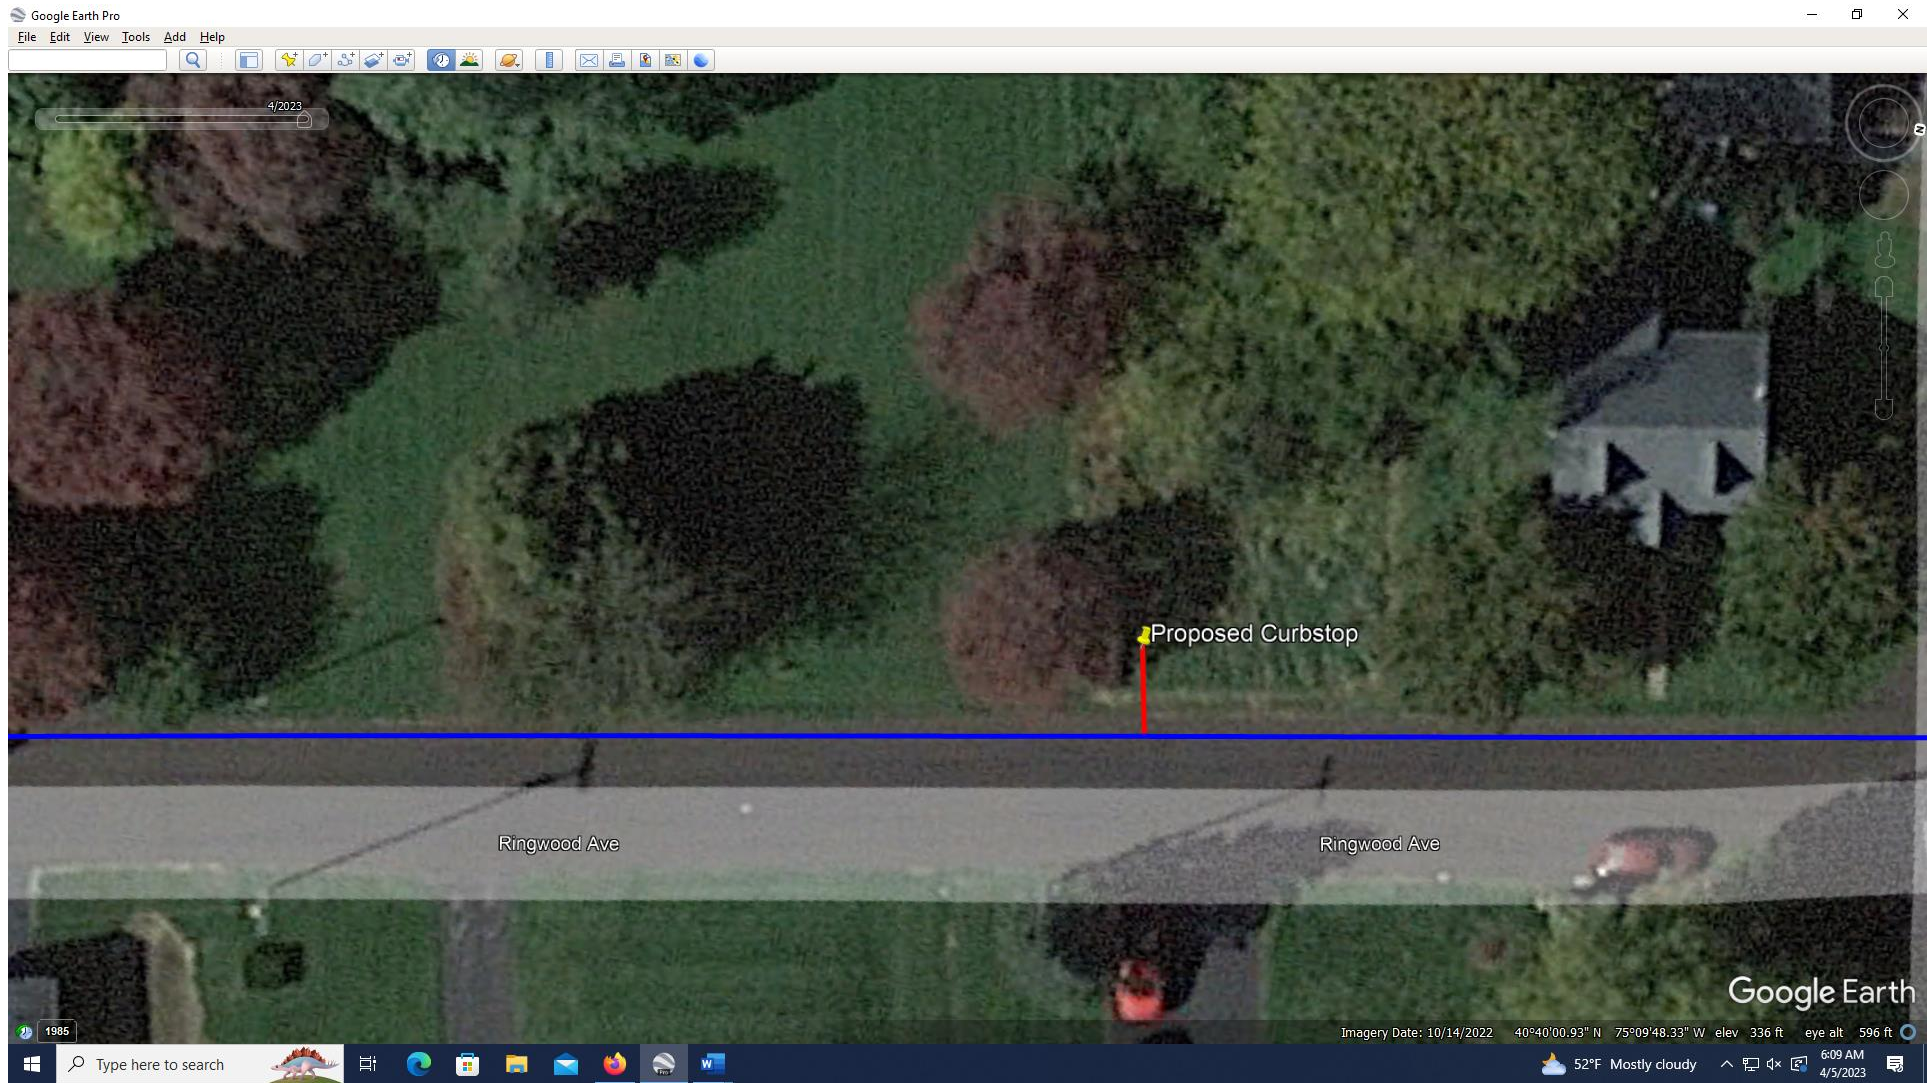

8" DIP main shown in BLUE

Proposed 1" water service shown in RED